


2101 Aging of water treatment facilities (%)



No. of Utilities:1543

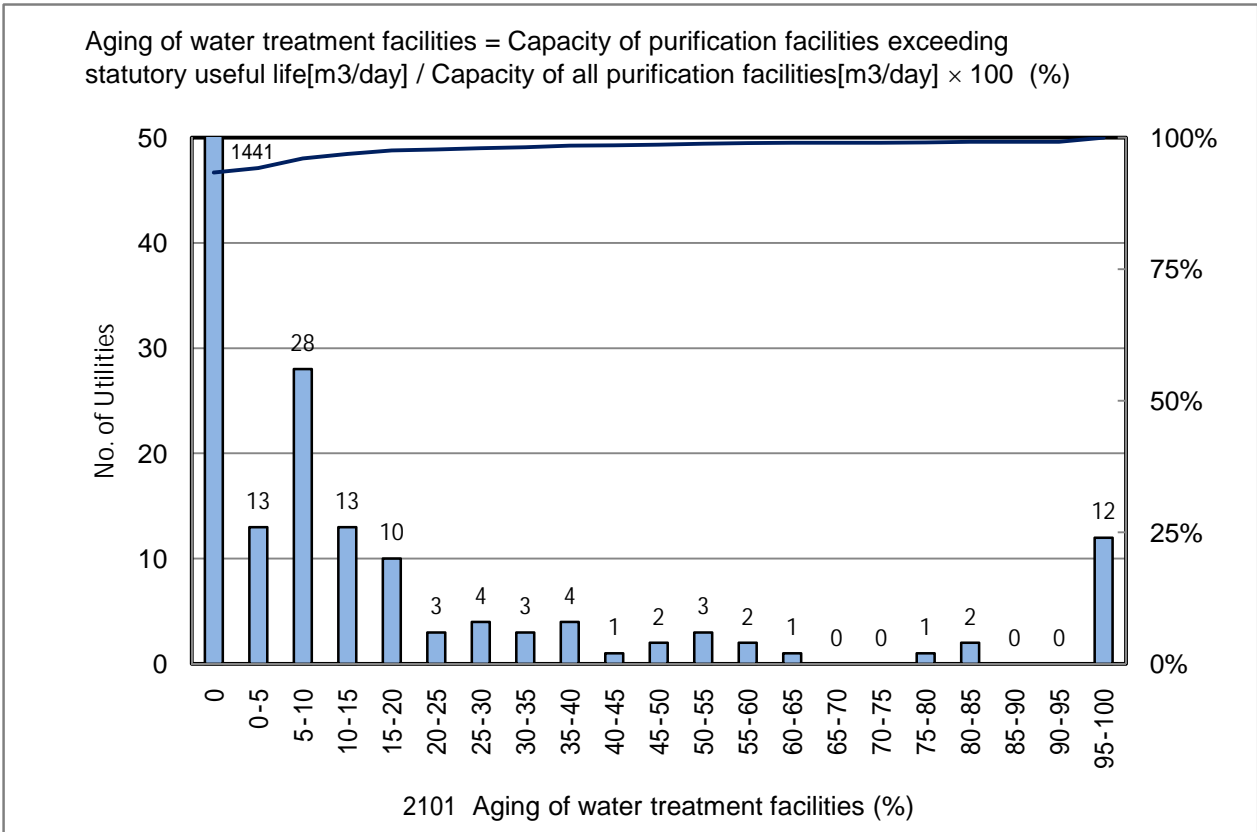

Percentile Value

W.S.	2004	2005	2006	Rem
95%		6.1	6.5	
80%		0.0	0.0	
75%		0.0	0.0	
50%		0.0	0.0	
25%		0.0	0.0	
20%		0.0	0.0	
5%		0.0	0.0	

Tendency of past 3 years

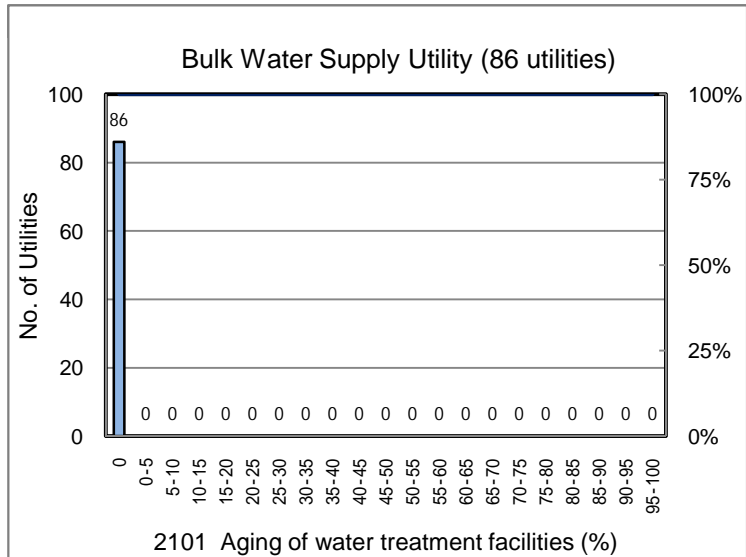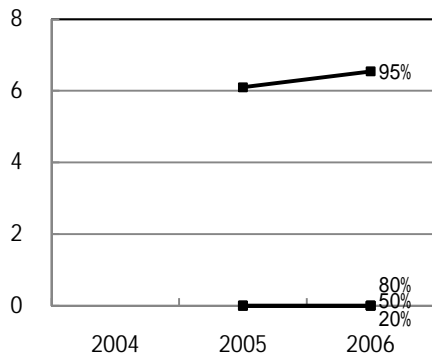

Percentile Value

B.W.S.	2006	Rem
80%	0.0	
50%	0.0	