


4002 Energy consumption per 1 m3 transmission input (MJ/m3)

No. of Utilities:1564

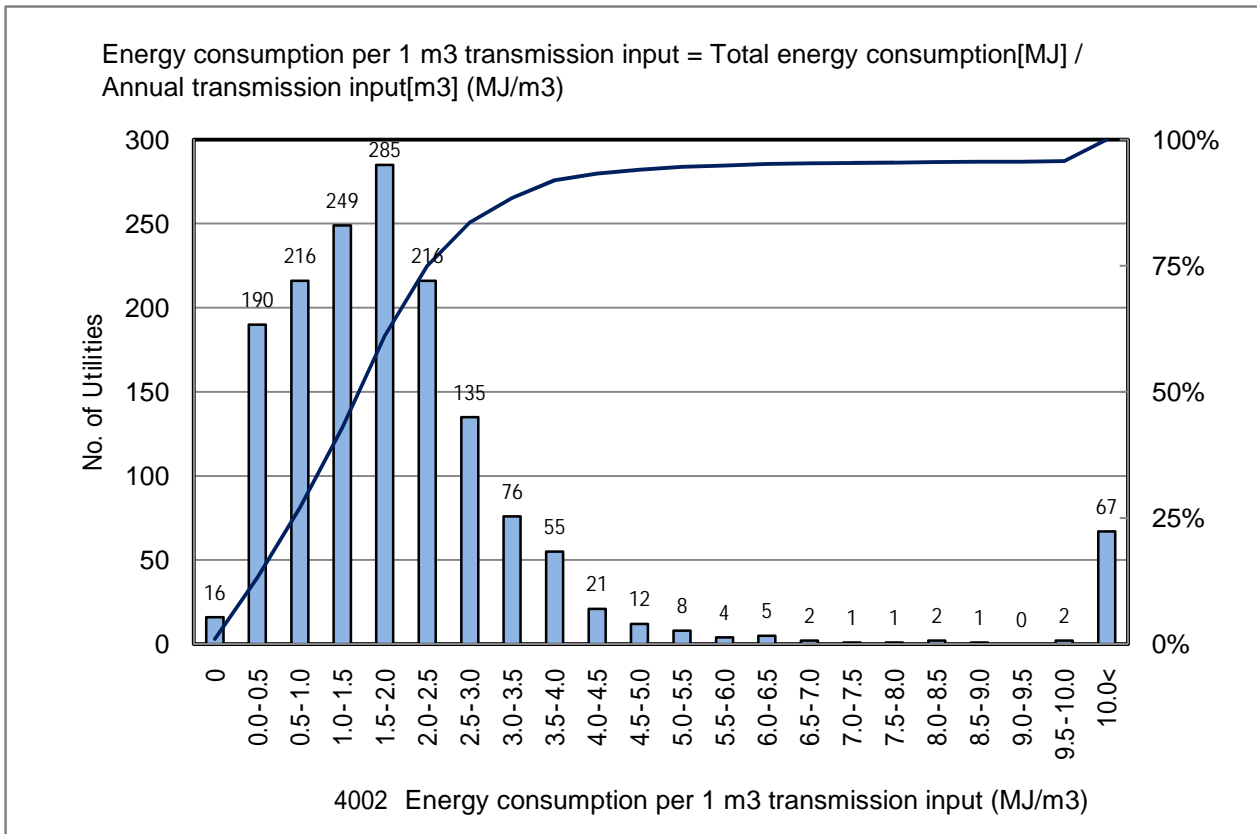

Percentile Value

W.S.	2004	2005	2006	Rem
95%		20.40	6.08	
80%		2.97	2.78	
75%		2.63	2.52	
50%		1.74	1.68	
25%		0.97	0.94	
20%		0.80	0.78	
5%		0.20	0.17	

Tendency of past 3 years

