


# 5109 Hour of water interruption or water turbidity (hour)

No. of Utilities:1564

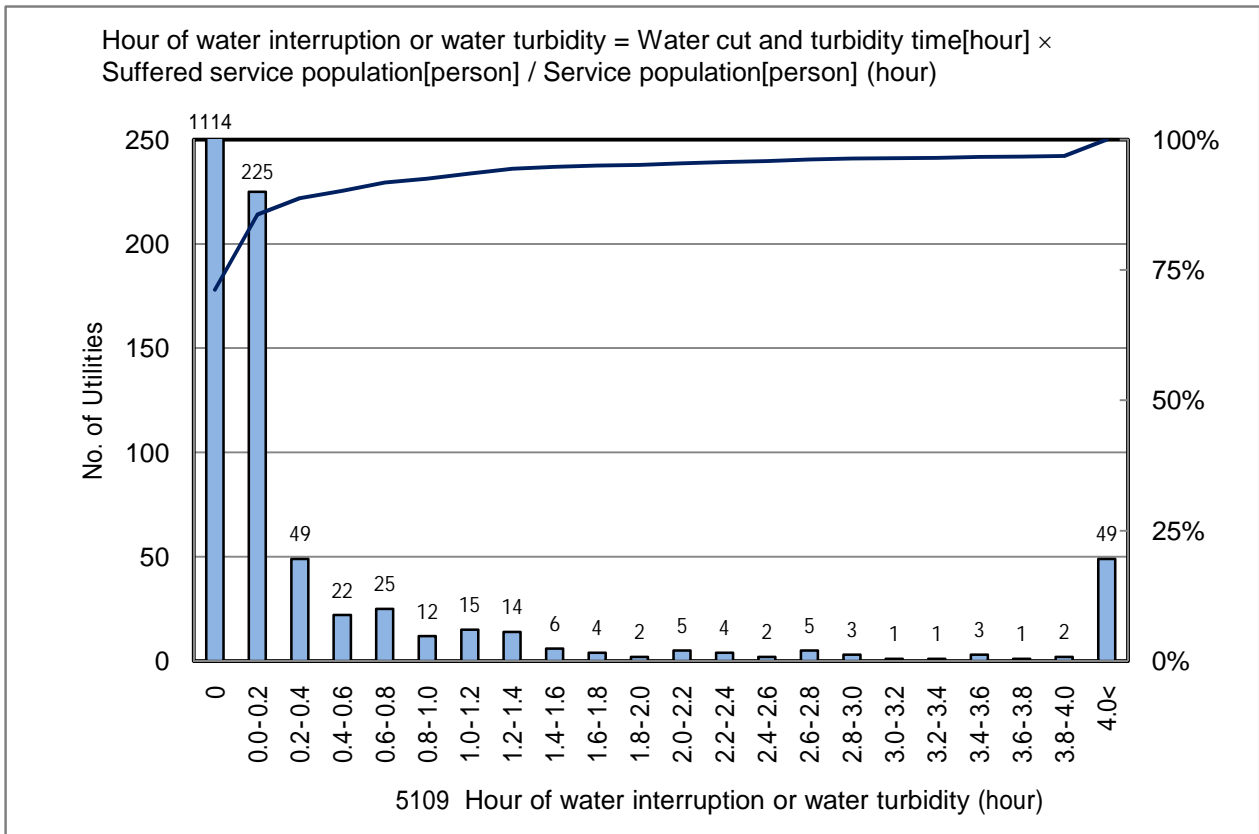

Percentile Value

W.S.	2004	2005	2006	Rem
95%		2.08	1.76	
80%		0.07	0.05	
75%		0.02	0.01	
50%		0.00	0.00	
25%		0.00	0.00	
20%		0.00	0.00	
5%		0.00	0.00	

Tendency of past 3 years

